



DETAIL
PROPER METHOD TO RACK
HAMMERHEAD SEPARABLE SPLICES
HALF SIZE SCALE: 3/4"=1'-0"

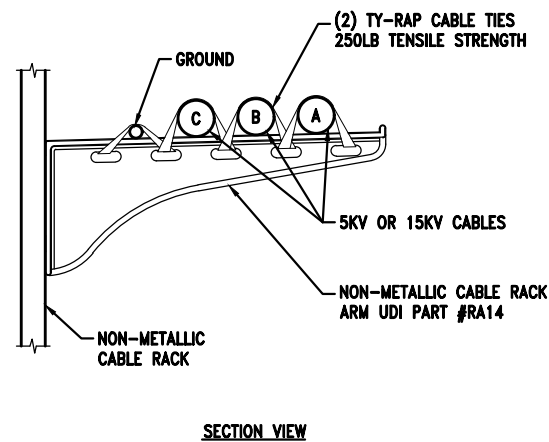

DETAIL
CABLE RACK DETAIL
HALF SIZE SCALE: 1 1/2"=1'-0"

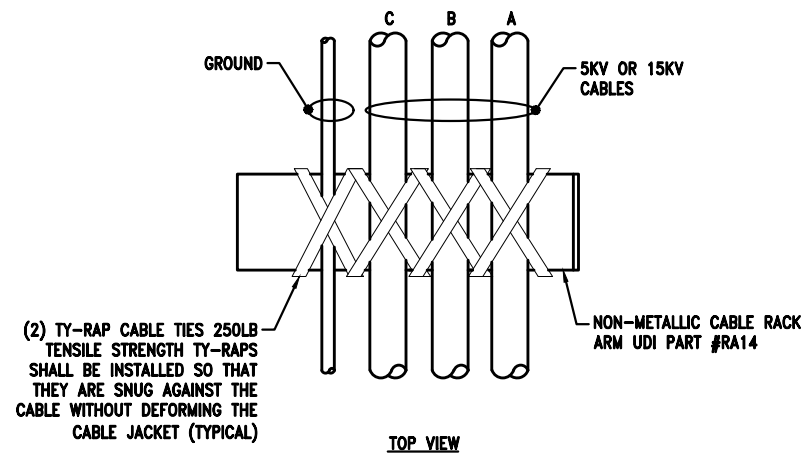

GENERAL NOTES:

1. SEE GROUNDING, LABELING, AND RACK DETAILS FOR RELATED REQUIREMENTS.
2. SEE SPECIFICATION 260513 FOR SPLICE ASSEMBLY REQUIREMENTS.

RACK SPACING		
CABLE SIZE	"A" IN FEET	"B" IN FEET
2/0	4.5	3.0
4/0	4.0	3.0
350	3.0	3.0
500	2.5	2.5
750	2.0	2.0

TABLE VALUES APPLY TO 5KV AND
15KV TYPE MV-105 CABLE ONLY

REVISIONS

NO.	DATE	BY	DESCRIPTION
1	03/01/2019	KDM	2019 F&I STANDARD DETAILS
2	03/01/2020	KDM	2020 F&I STANDARD DETAILS

PROJECT MANAGER:
—
PROJECT ENGINEER:
—
DESIGN ENGINEER:
—
DRAFTER:
—
SCALE:
AS NOTED
DATE:
—
CHECKED/APPROVED BY:
—



SEA-TAC INTERNATIONAL AIRPORT

PROJECT: F&I STANDARD DETAILS

SHEET TITLE: **PROPER SPLICE ORIENTATION
AND CABLE RACK SPACING**

WORK PROJECT NO.

CONSULTANT'S NO.

PORT OF SEATTLE NO.

260513 02